



S.U.B. | Customer  
← | →

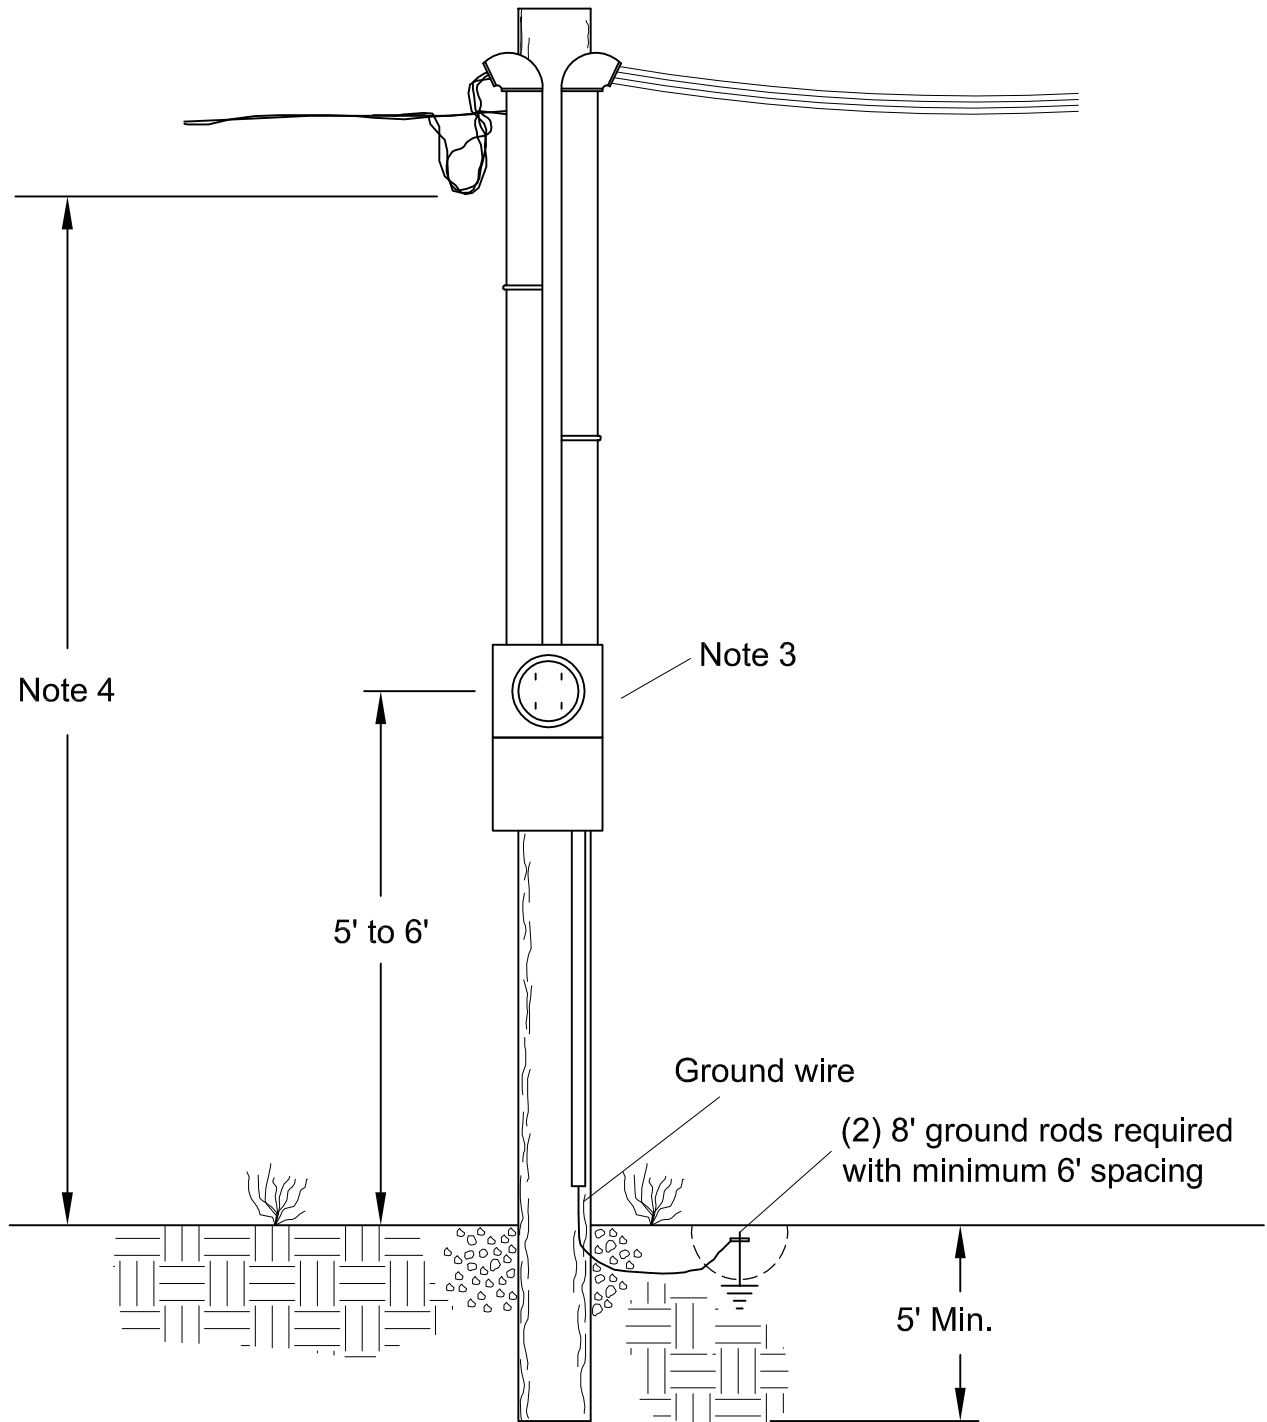


|   |  |   |
|---|--|---|
|  | <p><b>SPRINGFIELD UTILITY BOARD</b><br/>ENGINEERING STANDARD DISTRIBUTION<br/>PROCEDURES &amp; POLICIES<br/>TYPICAL OVERHEAD MOBILE HOME SERVICE</p> | <p>DATE   DWN   STD   CHK   APP<br/><u>3/25/2010   SK   SK   EH   TJ</u></p> <p>STANDARD NUMBER<br/><b>ESD 0103</b><br/>Page 1 of 2</p> |
|---|--|---|

NOTES:

1. Customer shall provided and install a pressure treated pole not less than 6"x6" square or 5-1/2" diameter at top (equivalent to class 6). Pole length to be consistent with minimum ground clearance requirements in Note 4, but not less than 20'. All meters, switches and conduits must be on one side of pole to provide an unobstructed climbing space.
2. Approved service equipment provided by customers includes conduit, meter base, ground rod, conductors, and weather proof disconnect switch.
3. Refer to ESD 0090 for details regarding S.U.B. requirements for meter installations. Meter location subject to approval by S.U.B.
4. Vertical clearance above ground shall be:
  - A. Minimum at service entrance – 10 feet 6 inches
  - B. Minimum over residential driveways or commercial areas not subject to truck traffic – 16 feet
  - C. Minimum over roads, streets, alleys, and other areas subject to truck traffic – 16 feet 6 inches
5. Guying may be necessary.

| REVISIONS |                              |
|-----------|------------------------------|
| Date      | Description                  |
| 8/24/83   | Created                      |
| 3/25/10   | Reformatted, drawing updated |

|   |   |   |
|---|---|---|
|  | <p><b>SPRINGFIELD UTILITY BOARD</b><br/>         ENGINEERING STANDARD DISTRIBUTION<br/>         PROCEDURES &amp; POLICIES<br/>         TYPICAL OVERHEAD MOBILE HOME SERVICE</p> | <p><u>DATE   DWN   STD   CHK   APP</u><br/> <u>3/25/2010   SK   SK   EH   TJ</u></p> <p>STANDARD NUMBER<br/> <b>ESD 0103</b><br/>         Page 2 of 2</p> |
|---|---|---|