


NOTES:

1. ID STAKE MINIMUM 2"x4" BURIED VERTICALLY IN GROUND AT DUCT END WITH RED TAPE.
2. ID STAKE REQUIRED AT EACH END OF CASING SPECIFYING NUMBER, SIZE, AND UTILITY.
3. END CAPS FOR CASING ARE REQUIRED AT EACH END.
4. LOCATE WIRE IS REQUIRED TO BE RUN WITH CASING AS WELL AS WRAPPED AROUND THE LOCATE STAKE.

SCALE: N.T.S.
DRAWN BY: LSB
CONSTRUCTION: <i>Carson</i>
ENGINEERING: <i>KPL</i>

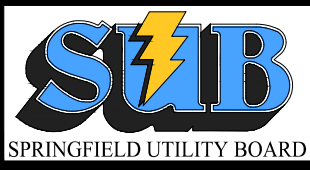

WATER DIVISION STANDARD DRAWING
SPARE CASING DETAIL

DRAWING NUMBER
W1.27
REVISED: 02-03-2020

SPECIFICATION NOTE:

THE SPECIFICATION REFERENCE(S), IF PROVIDED, IN THIS STANDARD ARE FOR INFORMATIONAL PURPOSES ONLY AND MAY NOT BE COMPLETE. IT IS THE CONTRACTORS RESPONSIBILITY TO ENSURE THAT ANY INSTALLATION PERFORMED MEETS THE REQUIREMENTS SET FORTH IN THE STANDARD CONSTRUCTION SPECIFICATIONS AND ANY OTHER APPLICABLE STANDARD.